

ENGINEERING STANDARD

OAK RIDGE TENNESSEE

NUMBER	ES-5.12-1
DATE	8-3-84
REVISED	
PAGE	1 of 1

FIRE DAMPER - FIRE PARTITION - FRAME MOUNTED

NOTES


1. ALL FIRE DAMPER INSTALLATIONS SHALL BE INSPECTED AND APPROVED BY FIRE DEPARTMENT. DAMPER, OPERATION AND INSTALLATION SHALL BE IN ACCORDANCE WITH NFPA STANDARD 90A.

LOCATE FOR SNUG FIT WITH DAMPER BUT NOT RESTRICTIVE. DAMPER SHALL BE MOVABLE BY HAND.

WARNING

DO NOT FASTEN FRAMES TO DAMPER.

CARBON STEEL
L 1-1/2 x 1-1/2 x 1/8
FRAME 4 SIDES.
TYPICAL BOTH
DAMPER FACES

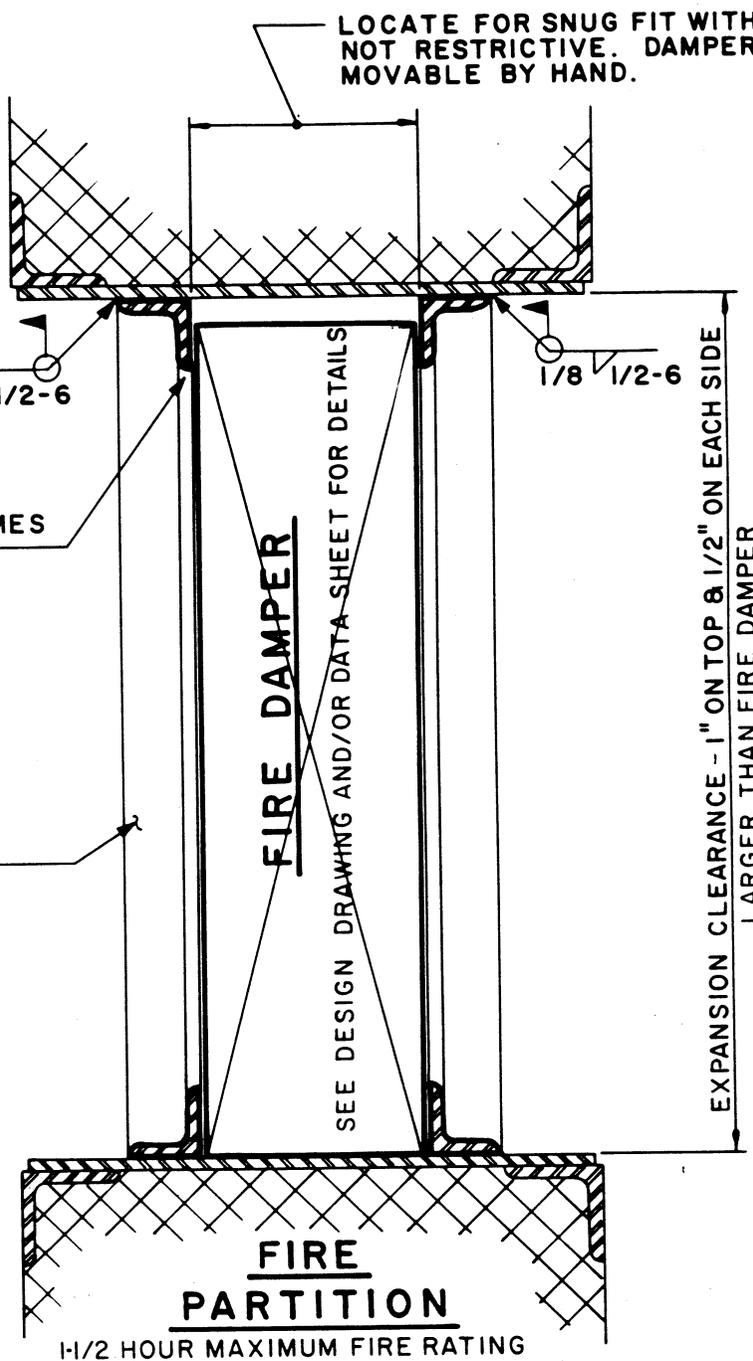

APPROVED BY

W. E. Wharton

NUMBER

ES-5.12-1